

## Stainless-Steel Titen HD® Design Information — Concrete

## Stainless-Steel Titen HD Anchor Product Data

Size (in.)	Model No. (Type 316)	Model No. (Type 304)	Drill Bit Dia. (in.)	Wrench Size (in.)	Quantity	
					Box	Carton
3/8 x 3	THD37300H6SS	THD37300H4SS	3/8	9/16	50	200
3/8 x 4	THD37400H6SS	THD37400H4SS	3/8	9/16	50	200
3/8 x 5	THD37500H6SS	THD37500H4SS	3/8	9/16	50	100
3/8 x 6	THD37600H6SS	THD37600H4SS	3/8	9/16	50	100
1/2 x 3	THD50300H6SS	THD50300H4SS	1/2	3/4	25	100
1/2 x 4	THD50400H6SS	THD50400H4SS	1/2	3/4	20	80
1/2 x 5	THD50500H6SS	THD50500H4SS	1/2	3/4	20	80
1/2 x 6	THD50600H6SS	THD50600H4SS	1/2	3/4	20	80
1/2 x 6 1/2	THD50612H6SS	THD50612H4SS	1/2	3/4	20	40
1/2 x 8	THD50800H6SS	THD50800H4SS	1/2	3/4	20	40
5/8 x 4	THDB62400H6SS	THDB62400H4SS	5/8	15/16	10	40
5/8 x 5	THDB62500H6SS	THDB62500H4SS	5/8	15/16	10	40
5/8 x 6	THDB62600H6SS	THDB62600H4SS	5/8	15/16	10	40
5/8 x 6 1/2	THDB62612H6SS	THDB62612H4SS	5/8	15/16	10	40
5/8 x 8	THDB62800H6SS	THDB62800H4SS	5/8	15/16	10	20
3/4 x 4	THD75400H6SS	THD75400H4SS	3/4	1 1/8	10	40
3/4 x 5	THD75500H6SS	THD75500H4SS	3/4	1 1/8	5	20
3/4 x 6	THD75600H6SS	THD75600H4SS	3/4	1 1/8	5	20
3/4 x 7	THD75700H6SS	THD75700H4SS	3/4	1 1/8	5	10
3/4 x 8 1/2	THD75812H6SS	THD75812H4SS	3/4	1 1/8	5	10

Stainless-Steel Titen HD Installation Information<sup>1</sup>

Characteristic	Symbol	Units	Nominal Anchor Diameter (in.)								
			3⁄8		1⁄2		5⁄8		3⁄4		
Installation Information											
Nominal Diameter	$d_a(d_o)^4$	in.	3⁄8		1⁄2		5⁄8		3⁄4		
Drill Bit Diameter	$d_{bit}$	in.	3⁄8		1⁄2		5⁄8		3⁄4		
Minimum Baseplate Clearance Hole Diameter <sup>2</sup>	$d_c$	in.	1⁄2		5⁄8		3⁄4		7⁄8		
Maximum Installation Torque <sup>3</sup>	$T_{inst,max}$	ft.-lbf.	40		70		85		150		
Maximum Impact Wrench Torque Rating	$T_{impact,max}$	ft.-lbf.	150		345		345		380		
Minimum Hole Depth	$h_{hole}$	in.	2¾	3½	3¾		4½	4½	6	6	6¾
Nominal Embedment Depth	$h_{nom}$	in.	2½	3¼	3¼		4	4	5½	5½	6¼
Effective Embedment Depth	$h_{ef}$	in.	1.40	2.04	1.86		2.50	2.31	3.59	3.49	4.13
Critical Edge Distance	$c_{ac}$	in.	4½	5½	6		5¾	6	6¾	6¾	7¾
Minimum Edge Distance	$c_{min}$	in.	1¾	1¾	1¾	2¼	1¾	1¾	1¾	1¾	1¾
Minimum Spacing	$s_{min}$	in.	3	3	4	3	3	3	3	3	3
Minimum Concrete Thickness	$h_{min}$	in.	4	5	5		6¼	6	8½	8¾	10
Anchor Data											
Yield Strength	$f_{ya}$	psi	98,400		91,200		83,200		92,000		
Tensile Strength	$f_{uta}$	psi	123,000		114,000		104,000		115,000		
Minimum Tensile and Shear Stress Area	$A_{se}^5$	in. <sup>2</sup>	0.099		0.1832		0.276		0.414		
Axial Stiffness in Service Load Range — Uncracked Concrete	$\beta_{uncr}$	lb./in.	807,700		269,085		111,040		102,035		
Axial Stiffness in Service Load Range — Cracked Concrete	$\beta_{cr}$	lb./in.	113,540		93,675		94,400		70,910		

For SI: 1 in. = 25.4 mm, 1 ft.-lbf. = 1.356 N-m, 1 psi = 6.89 kPa, 1 in.<sup>2</sup> = 645 mm<sup>2</sup>, 1 lb./in. = 0.175 N/mm.

- The information presented in this table is to be used in conjunction with the design criteria of ACI 318-14 Chapter 17 or ACI 318-11 Appendix D, as applicable.
- The minimum hole size must comply with applicable code requirements for the connected element.
- $T_{inst,max}$  applies to installations using a calibrated torque wrench.
- For the 2006 IBC  $d_o$  replaces  $d_a$ . The notation in parenthesis is for the 2006 IBC.

\* See p. 13 for an explanation of the load table icons.

## Stainless-Steel Titen HD® Design Information — Concrete

Stainless-Steel Titen HD Characteristic Tension Strength Design Values<sup>1,5</sup>


Characteristic	Symbol	Units	Nominal Anchor Diameter (in.)							
			3⁄8	1⁄2	5⁄8	3⁄4	1	1 1⁄4	1 1⁄2	2
Anchor Category	1, 2 or 3	—	1							
Nominal Embedment Depth	$h_{nom}$	in.	2 1⁄2	3 1⁄4	3 1⁄4	4	4	5 1⁄2	5 1⁄2	6 1⁄4
Steel Strength in Tension ( ACI 318-14 17.4.1 or ACI 318-11 Section D.5.1)										
Tension Resistance of Steel	$N_{sa}$	lbf.	12,177	20,885	28,723	47,606				
Strength Reduction Factor — Steel Failure <sup>2</sup>	$\phi_{sa}$	—	0.75							
Concrete Breakout Strength in Tension (ACI 318-14 17.4.2 or ACI 318 Section D.5.2)										
Effective Embedment Depth	$h_{ef}$	in.	1.40	2.04	1.86	2.50	2.31	3.59	3.49	4.13
Critical Edge Distance	$c_{ac}$	in.	4 1⁄2	5 1⁄2	6	5 3⁄4	6	6 3⁄8	6 3⁄4	7 3⁄8
Effectiveness Factor — Uncracked Concrete	$k_{uncr}$	—	27	24	27	24	24	24	27	27
Effectiveness Factor — Cracked Concrete	$k_{cr}$	—	21	17	17	17	17	17	17	21
Modification Factor	$\Psi_{c,N}$	—	1							
Strength Reduction Factor — Concrete Breakout Failure <sup>3</sup>	$\phi_{cb}$	—	0.65							
Pullout Strength in Tension (ACI 318-14 17.4.3 or ACI 318-11 Section D.5.3)										
Pullout Resistance Uncracked Concrete ( $f'_c = 2,500$ psi)	$N_{p,uncr}$	lbf.	N/A <sup>4</sup>	N/A <sup>4</sup>	N/A <sup>4</sup>	N/A <sup>4</sup>	3,820 <sup>5</sup>	9,080 <sup>7</sup>	N/A <sup>4</sup>	N/A <sup>4</sup>
Pullout Resistance Cracked Concrete ( $f'_c = 2,500$ psi)	$N_{p,cr}$	lbf.	1,675 <sup>5</sup>	2,415 <sup>5</sup>	1,995 <sup>5</sup>	N/A <sup>4</sup>	N/A <sup>4</sup>	N/A <sup>4</sup>	N/A <sup>4</sup>	N/A <sup>4</sup>
Strength Reduction Factor — Pullout Failure <sup>6</sup>	$\phi_p$	—	0.65							
Tension Strength for Seismic Applications (ACI 318-14 17.2.3.3 or ACI 318-11 Section D.3.3.3)										
Nominal Pullout Strength for Seismic Loads ( $f'_c = 2,500$ psi)	$N_{p,eq}$	lbf.	1,675 <sup>5</sup>	2,415 <sup>5</sup>	1,995 <sup>5</sup>	N/A <sup>4</sup>	N/A <sup>4</sup>	N/A <sup>4</sup>	N/A <sup>4</sup>	N/A <sup>4</sup>
Strength Reduction Factor for Pullout Failure <sup>6</sup>	$\phi_{eq}$	—	0.65							

For **SI**: 1 in. = 25.4 mm, 1 ft.-lbf. = 1.356 N-m, 1 psi = 6.89 kPa, 1 in.<sup>2</sup> = 645 mm<sup>2</sup>, 1 lb./in. = 0.175 N/mm.

- The information presented in this table is to be used in conjunction with the design criteria of ACI 318-14 Chapter 17 or ACI 318-11 Appendix D, as applicable.
- The tabulated value of  $\phi_{sa}$  applies when the load combinations of Section 1605.2 of the IBC, ACI 318-14 Section 5.3 or ACI 318-11 Section 9.2 are used, as applicable. If the load combinations of ACI 318-11 Appendix C are used, the appropriate value of  $\phi$  must be determined in accordance with ACI 318 D.4.4(b), as applicable.
- The tabulated values of  $\phi_{cb}$  applies when both the load combinations of Section 1605.2 of the IBC, ACI 318-14 Section 5.3 or ACI 318-11 Section 9.2, as applicable, are used and the requirements of ACI 318-14 17.3.3(c) or ACI 318-11 D.4.3(c) for Condition B are met. Condition B applies where supplementary reinforcement is not provided in concrete. For installations where complying reinforcement can be verified, the  $\phi_{cb}$  factors described in ACI 318-14 17.3.3(c) or ACI 318-11 D.4.3(c), as applicable, may be used for Condition A. If the load combinations of ACI 318 Appendix C are used, the appropriate value of  $\phi$  must be determined in accordance with ACI 318 D.4.4(c) for Condition B.
- N/A denotes that pullout resistance does not govern and does not need to be considered.
- The characteristic pullout resistance for greater compressive strengths may be increased by multiplying the tabular value by  $(f'_c/2,500)^{0.5}$ .
- The tabulated values of  $\phi_p$  or  $\phi_{eq}$  applies when both the load combinations of ACI 318-14 Section 5.3 or ACI 318-11 Section 9.2, as applicable, are used and the requirements of ACI 318-14 17.3.3(c) or ACI 318-11 D.4.3(c) for Condition B are met. If the load combinations of ACI 318 Appendix C are used, the appropriate value of  $\phi$  must be determined in accordance with ACI 318 D.4.4(c) for Condition B.
- The characteristic pullout resistance for greater compressive strengths may be increased by multiplying the tabular value by  $(f'_c/2,500)^{0.4}$ .

\* See p. 13 for an explanation of the load table icons.

## Stainless-Steel Titen HD® Design Information — Concrete

Stainless-Steel Titen HD Characteristic Shear Strength Design Values<sup>1</sup>

Characteristic	Symbol	Units	Nominal Anchor Diameter (in.)							
			3⁄8	1⁄2	5⁄8	3⁄4				
Anchor Category	1, 2 or 3	—	1							
Nominal Embedment Depth	$h_{nom}$	in.	2½	3¼	3¼	4	4	5½	5½	6¼
Steel Strength in Shear (ACI 318-14 17.5.1 or ACI 318-11 Section D.6.1)										
Shear Resistance of Steel	$V_{sa}$	lb.	3,790	4,780	6,024	7,633	10,422	10,649	13,710	19,161
Strength Reduction Factor — Steel Failure <sup>2</sup>	$\phi_{sa}$	—	0.65							
Concrete Breakout Strength in Shear (ACI 318-14 17.5.2 or ACI 318-11 Section D.6.2)										
Nominal Diameter	$d_a(d_o)^4$	in.	0.375		0.500		0.625		0.750	
Load Bearing Length of Anchor in Shear	$l_e$	in.	1.40	2.04	1.86	2.50	2.31	3.59	3.49	4.13
Strength Reduction Factor — Concrete Breakout Failure <sup>3</sup>	$\phi_{cb}$	—	0.70							
Concrete Pryout Strength in Shear (ACI 318-14 17.5.3 or ACI 318-11 Section D.6.3)										
Coefficient for Pryout Strength	$k_{cp}$	—	1.0			2.0	1.0	2.0		
Strength Reduction Factor — Concrete Pryout Failure <sup>4</sup>	$\phi_{cp}$	—	0.70							
Shear Strength for Seismic Applications (ACI 318-14 17.2.3.3 or ACI 318-11 Section D.3.3.3)										
Shear Resistance — Single Anchor for Seismic Loads (f'c = 2,500 psi)	$V_{sa,eq}$	lb.	3,790	4,780	5,345	6,773	9,367	9,367	10,969	10,969
Strength Reduction Factor — Steel Failure <sup>2</sup>	$\phi_{eq}$	—	0.65							

For SI: 1 in. = 25.4mm, 1 lb. = 4.45N.

- The information presented in this table is to be used in conjunction with the design criteria of ACI 318-14 Chapter 17 or ACI 318-11 Appendix D, as applicable.
- The tabulated value of  $\phi_{sa}$  and  $\phi_{eq}$  applies when the load combinations of Section 1605.2 of the IBC, ACI 318-14 Section 5.3 or ACI 318-11 Section 9.2, as applicable, are used. If the load combinations of ACI 318 Appendix C are used, the appropriate value of  $f$  must be determined in accordance with ACI 318 D.4.4(b).
- The tabulated value of  $\phi_{cb}$  applies when both the load combinations of Section 1605.2.1 of the IBC, ACI 318-14 Section 5.3 or ACI 318-11 Section 9.2 are used and the requirements of ACI 318-14 17.3.3(c) or ACI 318-11 D.4.3(c) for Condition B are met. Condition B applies where supplementary reinforcement is not provided. For installations where


complying supplementary reinforcement can be verified, the  $\phi_{cb}$  factors described in ACI 318-14 17.3.3(c) or ACI 318-11 D.4.3(c) for Condition A are allowed. If the load combinations of ACI 318-11 Appendix C are used, the appropriate value of  $\phi_{cb}$  must be determined in accordance with ACI 318-11 D.4.4(c).

- The tabulated value of  $\phi_{cp}$  applies when both the load combinations of IBC Section 1605.2, ACI 318-14 5.3 or ACI 318-11 Section 9.2 are used and the requirements of ACI 318-14 17.3.3(c) or ACI 318-11 D.4.3(c) for Condition B are met. If the load combinations of ACI 318-11 Appendix C are used, appropriate value of  $\phi_{cp}$  must be determined in accordance with ACI 318-11 Section D.4.4(c).
- The notation in parenthesis is for the 2006 IBC.


\* See p. 13 for an explanation of the load table icons.

## Stainless-Steel Titen HD® Design Information — Masonry

Stainless-Steel Titen HD Allowable Tension and Shear Loads in 8" Lightweight, Medium-Weight and Normal-Weight Grout-Filled CMU



Size in. (mm)	Drill Bit Dia. in.	Min. Embed. Depth in. (mm)	Critical Edge Dist. in. (mm)	Critical End Dist. in. (mm)	Critical Spacing Dist. in. (mm)	Values for 8" Lightweight, Medium-Weight or Normal-Weight Grout-Filled CMU			
						Tension Load		Shear Load	
						Ultimate lb. (kN)	Allowable lb. (kN)	Ultimate lb. (kN)	Allowable lb. (kN)
Anchor Installed in the Face of the CMU Wall (See Figure 1)									
3⁄8 (9.5)	3⁄8	2¾ (70)	12 (305)	12 (305)	8 (203)	2,125 (9.5)	425 (1.9)	2,850 (12.7)	570 (2.5)
1⁄2 (12.7)	1⁄2	3½ (89)	12 (305)	12 (305)	8 (203)	3,325 (14.8)	665 (3.0)	4,950 (22.0)	990 (4.4)
5⁄8 (15.9)	5⁄8	4½ (114)	12 (305)	12 (305)	8 (203)	3,850 (17.1)	770 (3.4)	4,925 (21.9)	985 (4.4)
¾ (19.1)	¾	5½ (140)	12 (305)	12 (305)	8 (203)	5,200 (23.1)	1,040 (4.6)	4,450 (19.8)	890 (4.0)

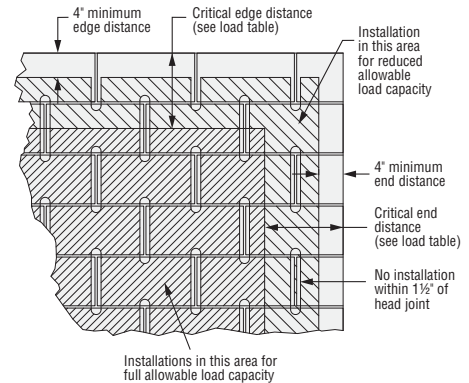


**Figure 1.** Shaded Area = Placement for Full and Reduced Allowable Load Capacity in Grout-Filled CMU

1. The tabulated allowable loads are based on a safety factor of 5.0 for installations under the IBC and IRC.
2. Values for 8"-wide, lightweight, medium-weight and normal-weight concrete masonry units.
3. The masonry units must be fully grouted.
4. The minimum specified compressive strength of masonry,  $f'_m$ , at 28 days is 2,000 psi.
5. Embedment depth is measured from the outside face of the concrete masonry unit.
6. Allowable loads may be increased 33 1/3% for short-term loading due to wind or seismic forces where permitted by code.
7. Grout-filled CMU wall design must satisfy applicable design standards and be capable of withstanding applied loads.
8. Refer to allowable load-adjustment factors for spacing and edge distance on p. 129.

Stainless-Steel Titen HD Allowable Tension and Shear Loads in 8" Lightweight, Medium-Weight and Normal-Weight Hollow CMU



Size in. (mm)	Drill Bit Dia. in.	Min. Embed. Depth <sup>4</sup> in. (mm)	Critical Edge Dist. in. (mm)	Critical Spacing Dist. in. (mm)	8" Hollow CMU Loads Based on CMU Strength			
					Tension Load		Shear Load	
					Ultimate lb. (kN)	Allowable lb. (kN)	Ultimate lb. (kN)	Allowable lb. (kN)
Anchor Installed in Face Shell (See Figure 2)								
3/8 (9.5)	3/8	2 1/2 (64)	12 (305)	8 (203)	925 (4.1)	185 (0.8)	2,250 (10.0)	450 (2.0)
1/2 (12.7)	1/2	2 1/2 (64)	12 (305)	8 (203)	1,025 (4.6)	205 (0.9)	2,325 (10.3)	465 (2.1)
5/8 (15.9)	5/8	2 1/2 (64)	12 (305)	8 (203)	550 (2.4)	110 (0.5)	2,025 (9.0)	405 (1.8)
3/4 (19.1)	3/4	2 1/2 (64)	12 (305)	8 (203)	775 (3.4)	155 (0.7)	1,975 (8.8)	395 (1.8)

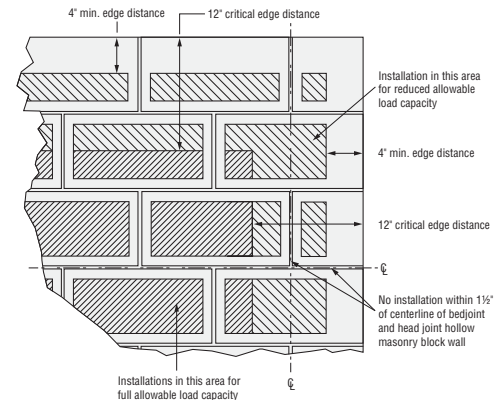

**Figure 2.** Stainless-Steel Titen HD Screw Anchor Installed in the Face of Hollow CMU Wall Construction

1. The tabulated allowable loads are based on a safety factor of 5.0 for installations under the IBC and IRC.
2. Values for 8"-wide, lightweight, medium-weight and normal-weight concrete masonry units.
3. The minimum specified compressive strength of masonry,  $f'_m$ , at 28 days is 2,000 psi.
4. Embedment depth is measured from the outside face of the concrete masonry unit and is based on the anchor being embedded an additional 1 1/4" through 1 1/4"-thick face shell.
5. Allowable loads may not be increased for short-term loading due to wind or seismic forces. CMU wall design must satisfy applicable design standards and be capable of withstanding applied loads.
6. Do not use impact wrenches to install in hollow CMU.
7. Set drill to rotation-only mode when drilling into hollow CMU.
8. Refer to allowable load-adjustment factors for spacing and edge distance on p. 129.
9. Anchors must be installed a minimum of 1 1/2" from vertical head joints and T-joints.  
Refer to Figure 2 for permitted and prohibited anchor installation locations.

\* See p. 13 for an explanation of the load table icons.

## Stainless-Steel Titen HD® Design Information — Masonry

## Load-Adjustment Factors for Stainless-Steel Titen HD Anchors in Face-of-Wall Installation in 8" Grout-Filled CMU: Edge Distance and Spacing, Tension and Shear Loads

## How to use these charts:

1. The following tables are for reduced edge distance and spacing.
2. Locate the anchor size to be used for either a tension and/or shear load application.
3. Locate the embedment (E) at which the anchor is to be installed.
4. Locate the edge distance ( $c_{act}$ ) or spacing ( $s_{act}$ ) at which the anchor is to be installed.
5. The load adjustment factor ( $f_c$  or  $f_s$ ) is the intersection of the row and column.
6. Multiply the allowable load by the applicable load adjustment factor.
7. Reduction factors for multiple edges or spacings are multiplied together.

Edge or End Distance Tension ( $f_c$ )

$c_{act}$ (in.)	Dia.	3/8	1/2	5/8	3/4
	E	2 3/4	3 1/2	4 1/2	5 1/2
	$c_{cr}$	12	12	12	12
	$c_{min}$	4	4	4	4
	$f_{cmin}$	0.80	0.81	1.00	1.00
4		0.80	0.81	1.00	1.00
6		0.85	0.86	1.00	1.00
8		0.90	0.91	1.00	1.00
10		0.95	0.95	1.00	1.00
12		1.00	1.00	1.00	1.00

See notes below.

Edge or End Distance Shear ( $f_c$ )  
Shear Load Parallel to Edge or End

$c_{act}$ (in.)	Dia.	3/8	1/2	5/8	3/4
	E	2 3/4	3 1/2	4 1/2	5 1/2
	$c_{cr}$	12	12	12	12
	$c_{min}$	4	4	4	4
	$f_{cmin}$	0.88	0.56	0.65	0.84
4		0.88	0.56	0.65	0.84
6		0.91	0.67	0.74	0.88
8		0.94	0.78	0.83	0.92
10		0.97	0.89	0.91	0.96
12		1.00	1.00	1.00	1.00

See notes below.

Edge or End Distance Shear ( $f_c$ ) Shear Load Perpendicular to Edge or End (Directed Toward Edge or End)

$c_{act}$ (in.)	Dia.	3/8	1/2	5/8	3/4
	E	2 3/4	3 1/2	4 1/2	5 1/2
	$c_{cr}$	12	12	12	12
	$c_{min}$	4	4	4	4
	$f_{cmin}$	0.93	0.48	0.66	0.69
4		0.93	0.48	0.66	0.69
6		0.95	0.61	0.75	0.77
8		0.97	0.74	0.83	0.85
10		0.98	0.87	0.92	0.92
12		1.00	1.00	1.00	1.00

1. E = embedment depth (inches).
2.  $c_{act}$  = actual end or edge distance at which anchor is installed (inches).
3.  $c_{cr}$  = critical end or edge distance for 100% load (inches).
4.  $c_{min}$  = minimum end or edge distance for reduced load (inches).
5.  $f_c$  = adjustment factor for allowable load at actual end or edge distance.
6.  $f_{cr}$  = adjustment factor for allowable load at critical end or edge distance.  $f_{cr}$  is always = 1.00.
7.  $f_{cmin}$  = adjustment factor for allowable load at minimum end or edge distance.
8.  $f_c = f_{cmin} + [(1 - f_{cmin}) (c_{act} - c_{min}) / (c_{cr} - c_{min})]$ .

Edge or End Distance Shear ( $f_c$ )  
Shear Load Perpendicular to Edge or End (Directed Away from Edge or End)

$c_{act}$ (in.)	Dia.	3/8	1/2	5/8	3/4
	E	2 3/4	3 1/2	4 1/2	5 1/2
	$c_{cr}$	12	12	12	12
	$c_{min}$	4	4	4	4
	$f_{cmin}$	0.93	0.48	0.66	0.69
4		0.93	0.48	0.66	0.69
6		0.95	0.61	0.75	0.77
8		0.97	0.74	0.83	0.85
10		0.98	0.87	0.92	0.92
12		1.00	1.00	1.00	1.00

Spacing Tension ( $f_s$ )

$s_{act}$ (in.)	Dia.	3/8	1/2	5/8	3/4
	E	2 3/4	3 1/2	4 1/2	5 1/2
	$s_{cr}$	8	8	8	8
	$s_{min}$	4	4	4	4
	$f_{smin}$	0.81	0.79	0.87	0.78
4		0.81	0.79	0.87	0.78
6		0.91	0.90	0.94	0.89
8		1.00	1.00	1.00	1.00

1. E = embedment depth (inches).
2.  $s_{act}$  = actual spacing distance at which anchors are installed (inches).
3.  $s_{cr}$  = critical spacing distance for 100% load (inches).
4.  $s_{min}$  = minimum spacing distance for reduced load (inches).
5.  $f_s$  = adjustment factor for allowable load at actual spacing distance.
6.  $f_{scr}$  = adjustment factor for allowable load at critical spacing distance.  $f_{scr}$  is always = 1.00.
7.  $f_{smin}$  = adjustment factor for allowable load at minimum spacing distance.
8.  $f_s = f_{smin} + [(1 - f_{smin}) (s_{act} - s_{min}) / (s_{cr} - s_{min})]$ .

Spacing Shear ( $f_s$ )

$s_{act}$ (in.)	Dia.	3/8	1/2	5/8	3/4
	E	2 3/4	3 1/2	4 1/2	5 1/2
	$s_{cr}$	8	8	8	8
	$s_{min}$	4	4	4	4
	$f_{smin}$	1.00	0.86	0.90	0.94
4		1.00	0.86	0.90	0.94
6		1.00	0.93	0.95	0.97
8		1.00	1.00	1.00	1.00

\* See p. 13 for an explanation of the load table icons.

## Stainless-Steel Titen HD® Design Information — Masonry


Load-Adjustment Factors for Stainless-Steel Titen HD Anchors in Face-of-Wall Installation  
in 8" Hollow CMU: Edge Distance and Spacing, Tension and Shear Loads

## How to use these charts:


1. The following tables are for reduced edge distance and spacing.
2. Locate the anchor size to be used for either a tension and/or shear load application.
3. Locate the embedment (E) at which the anchor is to be installed.
4. Locate the edge distance ( $c_{act}$ ) or spacing ( $s_{act}$ ) at which the anchor is to be installed.
5. The load adjustment factor ( $f_c$  or  $f_s$ ) is the intersection of the row and column.
6. Multiply the allowable load by the applicable load adjustment factor.
7. Reduction factors for multiple edges or spacings are multiplied together.

Edge Distance Tension ( $f_c$ )

$c_{act}$ (in.)	Dia.	3/8	1/2	5/8	3/4
	E	2 1/2	2 1/2	2 1/2	2 1/2
	$c_{cr}$	12	12	12	12
	$c_{min}$	4	4	4	4
	$f_{cmin}$	1.00	1.00	1.00	1.00
4		1.00	1.00	1.00	1.00
6		1.00	1.00	1.00	1.00
8		1.00	1.00	1.00	1.00
10		1.00	1.00	1.00	1.00
12		1.00	1.00	1.00	1.00

Edge Distance Shear ( $f_c$ )

$c_{act}$ (in.)	Dia.	3/8	1/2	5/8	3/4
	E	2 1/2	2 1/2	2 1/2	2 1/2
	$c_{cr}$	12	12	12	12
	$c_{min}$	4	4	4	4
	$f_{cmin}$	0.78	0.63	0.55	0.51
4		0.78	0.63	0.55	0.51
6		0.84	0.72	0.66	0.63
8		0.89	0.82	0.78	0.76
10		0.95	0.91	0.89	0.88
12		1.00	1.00	1.00	1.00




1. E = embedment depth (inches).
2.  $c_{act}$  = actual end or edge distance at which anchor is installed (inches).
3.  $c_{cr}$  = critical end or edge distance for 100% load (inches).
4.  $c_{min}$  = minimum end or edge distance for reduced load (inches).
5.  $f_c$  = adjustment factor for allowable load at actual end or edge distance.
6.  $f_{ccr}$  = adjustment factor for allowable load at critical end or edge distance.  
 $f_{ccr}$  is always = 1.00.
7.  $f_{cmin}$  = adjustment factor for allowable load at minimum end or edge distance.
8.  $f_c = f_{cmin} + [(1 - f_{cmin}) (c_{act} - c_{min}) / (c_{cr} - c_{min})]$ .

Spacing Tension ( $f_s$ )

## One Anchor per Cell

$c_{act}$ (in.)	Dia.	3/8	1/2	5/8	3/4
	E	2 1/2	2 1/2	2 1/2	2 1/2
	$c_{cr}$	8	8	8	8
	$c_{min}$	4	4	4	4
	$f_{smin}$	0.72	0.87	0.89	0.70
4		0.72	0.87	0.89	0.70
6		0.86	0.94	0.95	0.85
8		1.00	1.00	1.00	1.00




See notes below.

Spacing Tension ( $f_s$ )

## Two Anchors per Cell

$c_{act}$ (in.)	Dia.	3/8	1/2	5/8	3/4
	E	2 1/2	2 1/2	2 1/2	2 1/2
	$c_{cr}$	8	8	8	8
	$c_{min}$	4	4	4	4
	$f_{smin}$	1.00	1.00	1.00	0.78
4		1.00	1.00	1.00	0.78
6		1.00	1.00	1.00	0.89
8		1.00	1.00	1.00	1.00



See notes below.

Spacing Shear ( $f_s$ )

## One Anchor per Cell

$s_{act}$ (in.)	Dia.	3/8	1/2	5/8	3/4
	E	2 1/2	2 1/2	2 1/2	2 1/2
	$s_{cr}$	8	8	8	8
	$s_{min}$	4	4	4	4
	$f_{smin}$	0.81	1.00	0.71	0.74
4		0.81	1.00	0.71	0.74
6		0.91	1.00	0.86	0.87
8		1.00	1.00	1.00	1.00




1. E = embedment depth (inches).
2.  $s_{act}$  = actual spacing distance at which anchors are installed (inches).
3.  $s_{cr}$  = critical spacing distance for 100% load (inches).
4.  $s_{min}$  = minimum spacing distance for reduced load (inches).
5.  $f_s$  = adjustment factor for allowable load at actual spacing distance.
6.  $f_{scr}$  = adjustment factor for allowable load at critical spacing distance.  $f_{scr}$  is always = 1.00.
7.  $f_{smin}$  = adjustment factor for allowable load at minimum spacing distance.
8.  $f_s = f_{smin} + [(1 - f_{smin}) (s_{act} - s_{min}) / (s_{cr} - s_{min})]$ .

Spacing Shear ( $f_s$ )

## Two Anchors per Cell

$s_{act}$ (in.)	Dia.	3/8	1/2	5/8	3/4
	E	2 1/2	2 1/2	2 1/2	2 1/2
	$s_{cr}$	8	8	8	8
	$s_{min}$	4	4	4	4
	$f_{smin}$	0.76	1.00	0.75	0.75
4		0.76	1.00	0.75	0.75
6		0.88	1.00	0.88	0.88
8		1.00	1.00	1.00	1.00



\* See p. 13 for an explanation of the load table icons.